


# Modified Water Deliveries - L67 Pilot Test

17AUG18 18:17:20

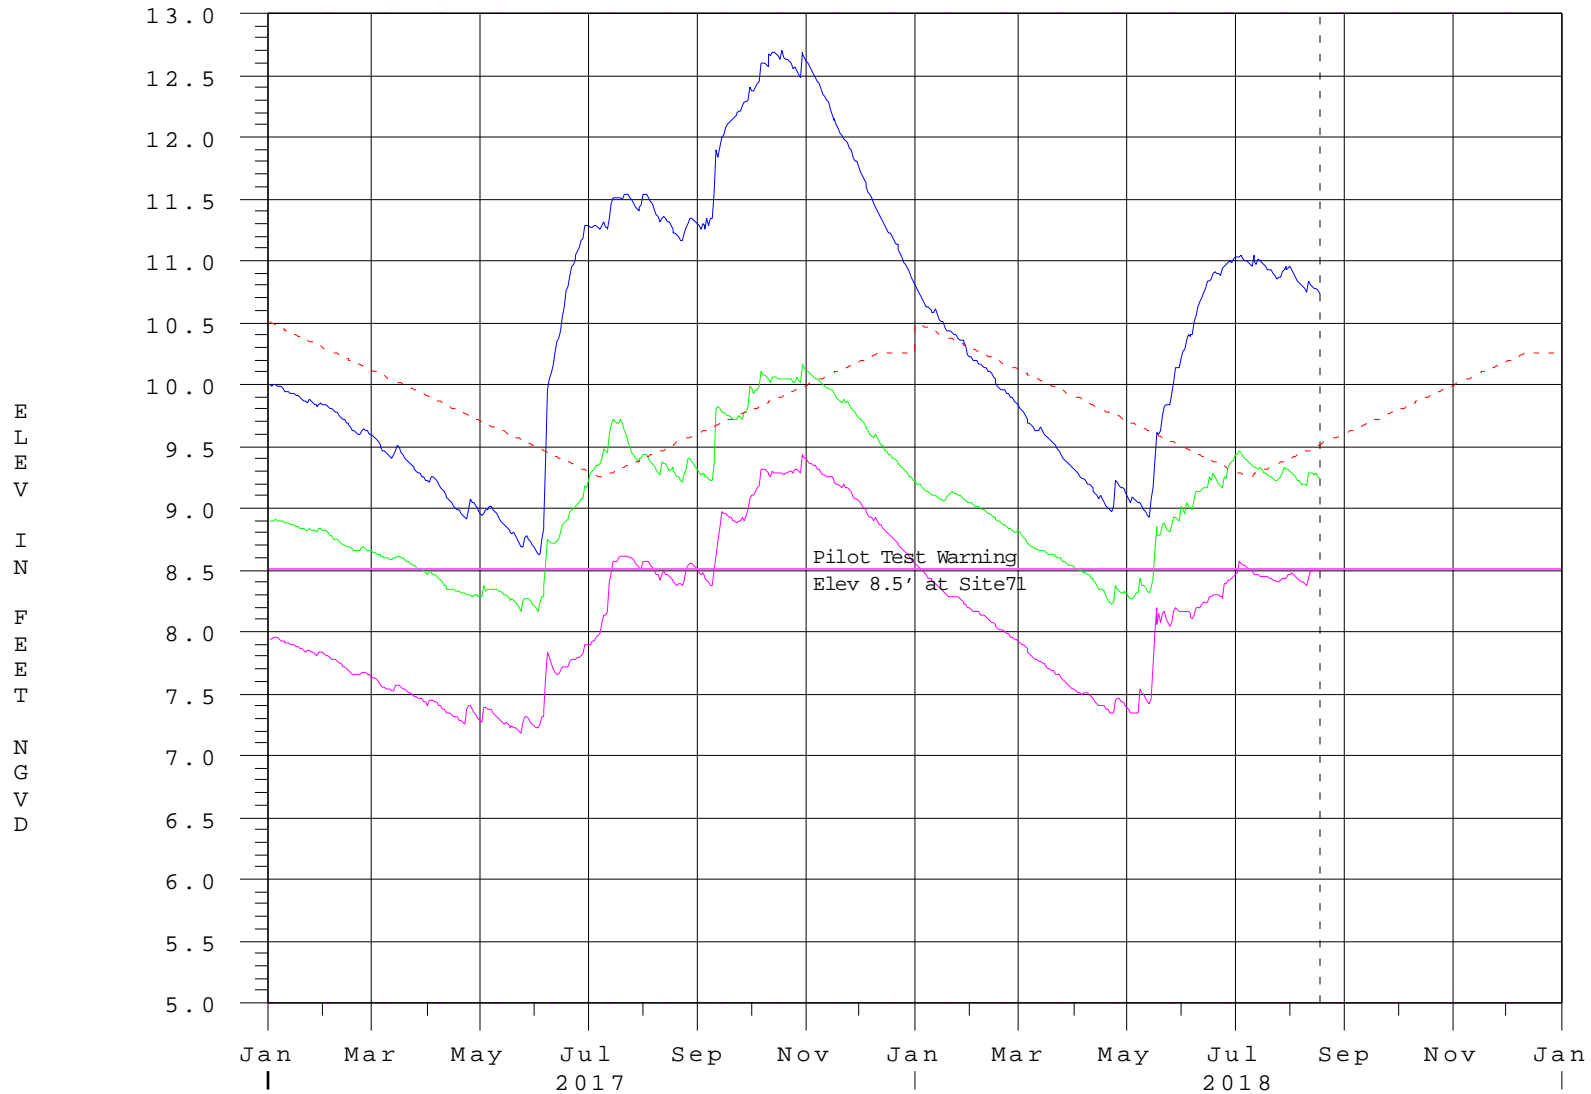

E  
L  
E  
V  
  
I  
N  
  
F  
E  
E  
T  
  
N  
G  
V  
D

Pilot Test Warning  
Elev 8.5' at Site71

- Site 64 Elev in WCA #3A
- Site 69 Elev between L67A & L67C
- Site 71 Elev in WCA #3B
- - - Zone E Regulation for WCA #3A