


Water Cons. Area #1 Compared to 1979-2016 Exceedance Statistics

22NOV17 06:00:45

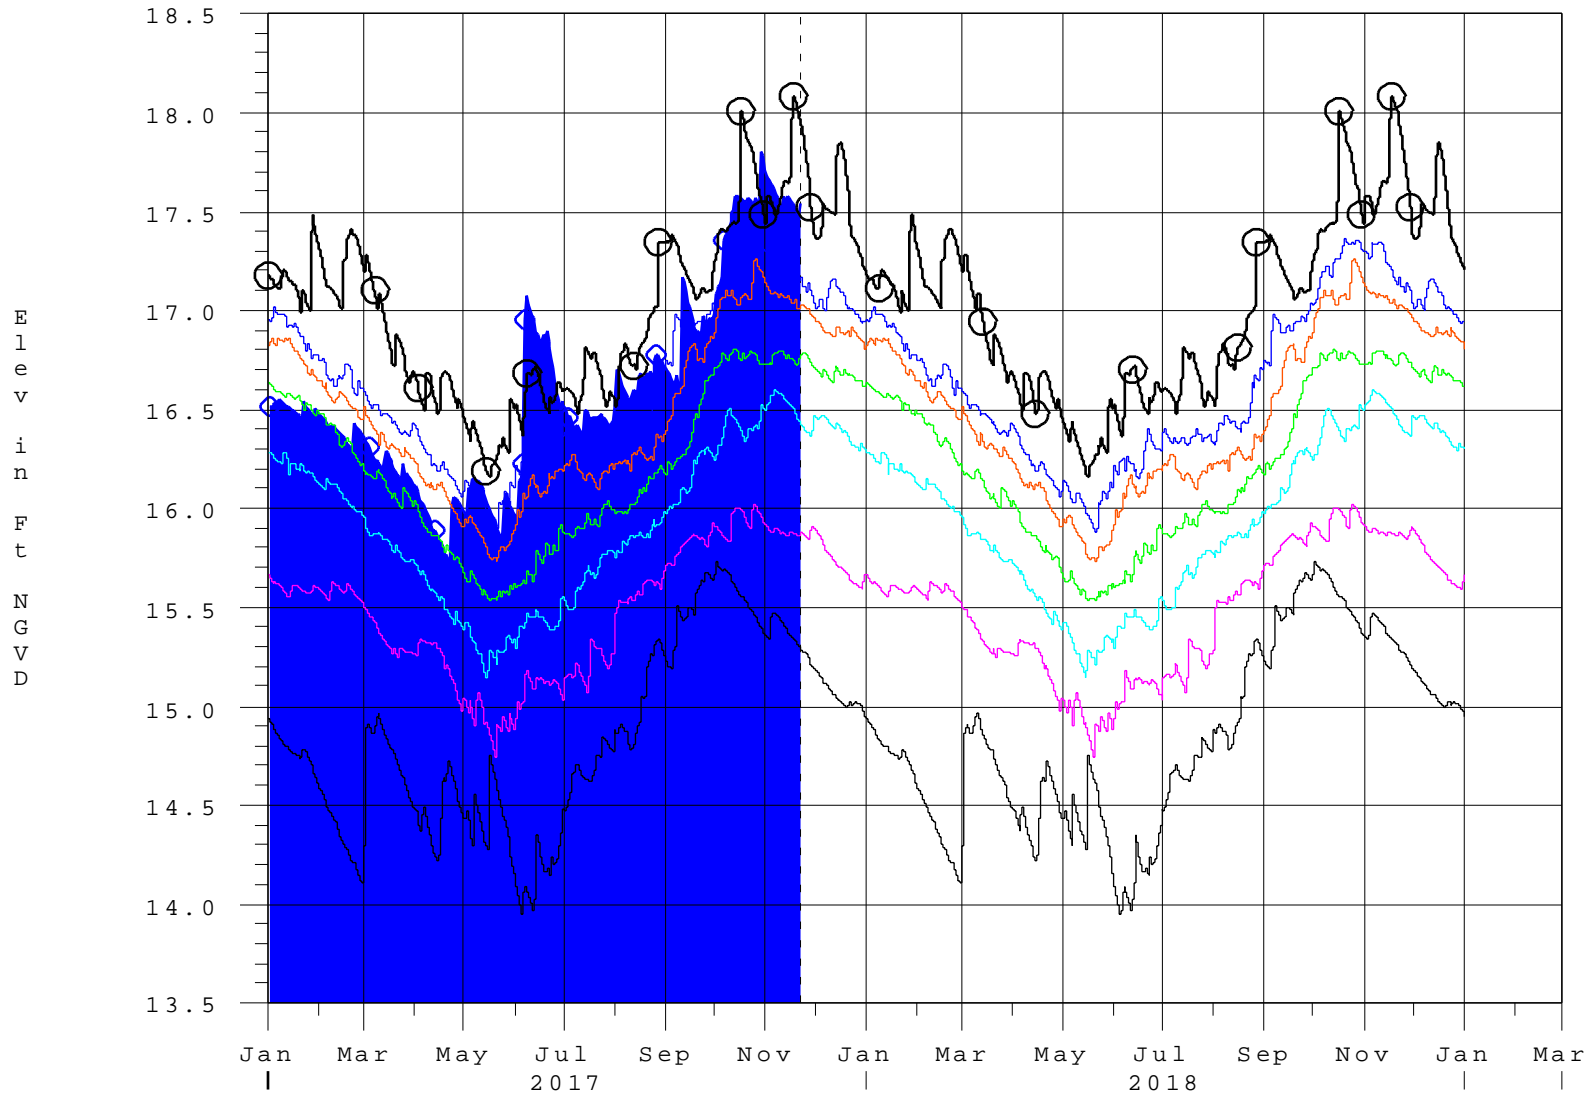

—◇— Avg Elev (Site 7,9,8T)
— 90% Exceed Value
— 75% Exceed Value
— 50% Exceed Value

— 25% Exceed Value
— 10% Exceed Value
— Min Exceed Value
—○— Max Exceed Value