


# Water Cons. Area #2A Compared to 1954-2016 Exceedance Statistics

22NOV17 06:00:47

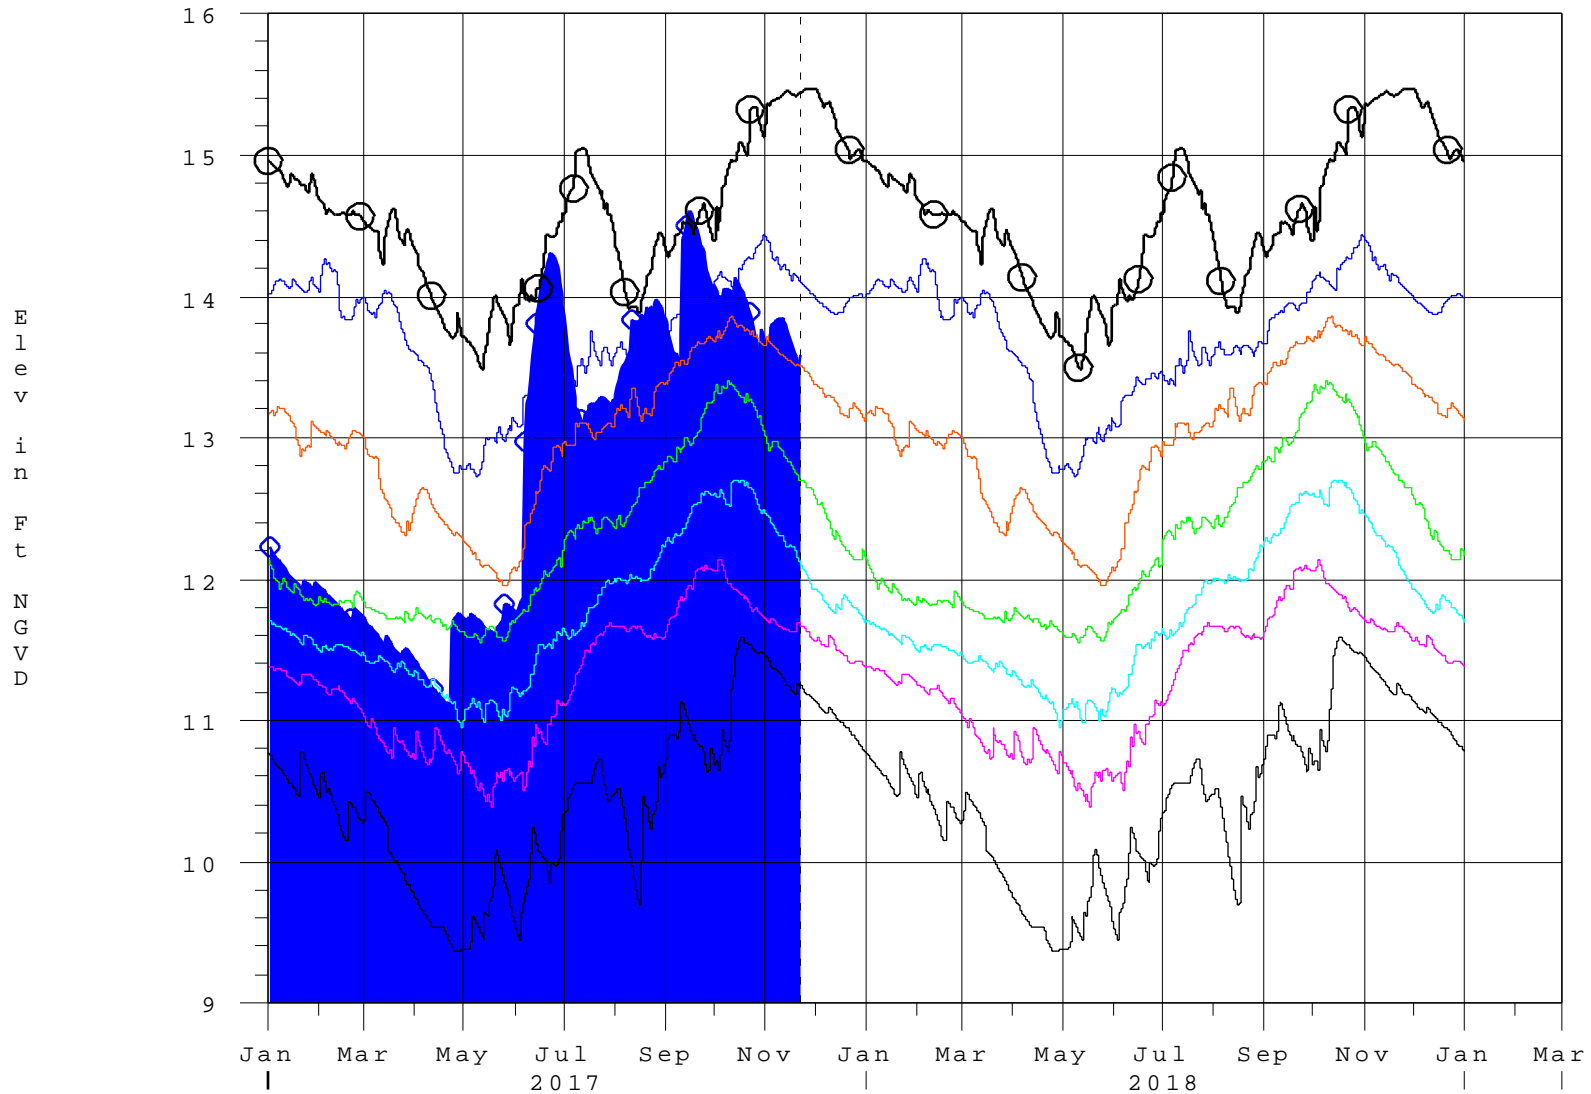

—◇— Site 2-17  
— 90% Exceed Value  
— 75% Exceed Value  
— 50% Exceed Value

— 25% Exceed Value  
— 10% Exceed Value  
— Min Exceed Value  
—○— Max Exceed Value