


Water Cons. Area #2A Compared to 1954-2016 Exceedance Statistics

19SEP17 23:45:32

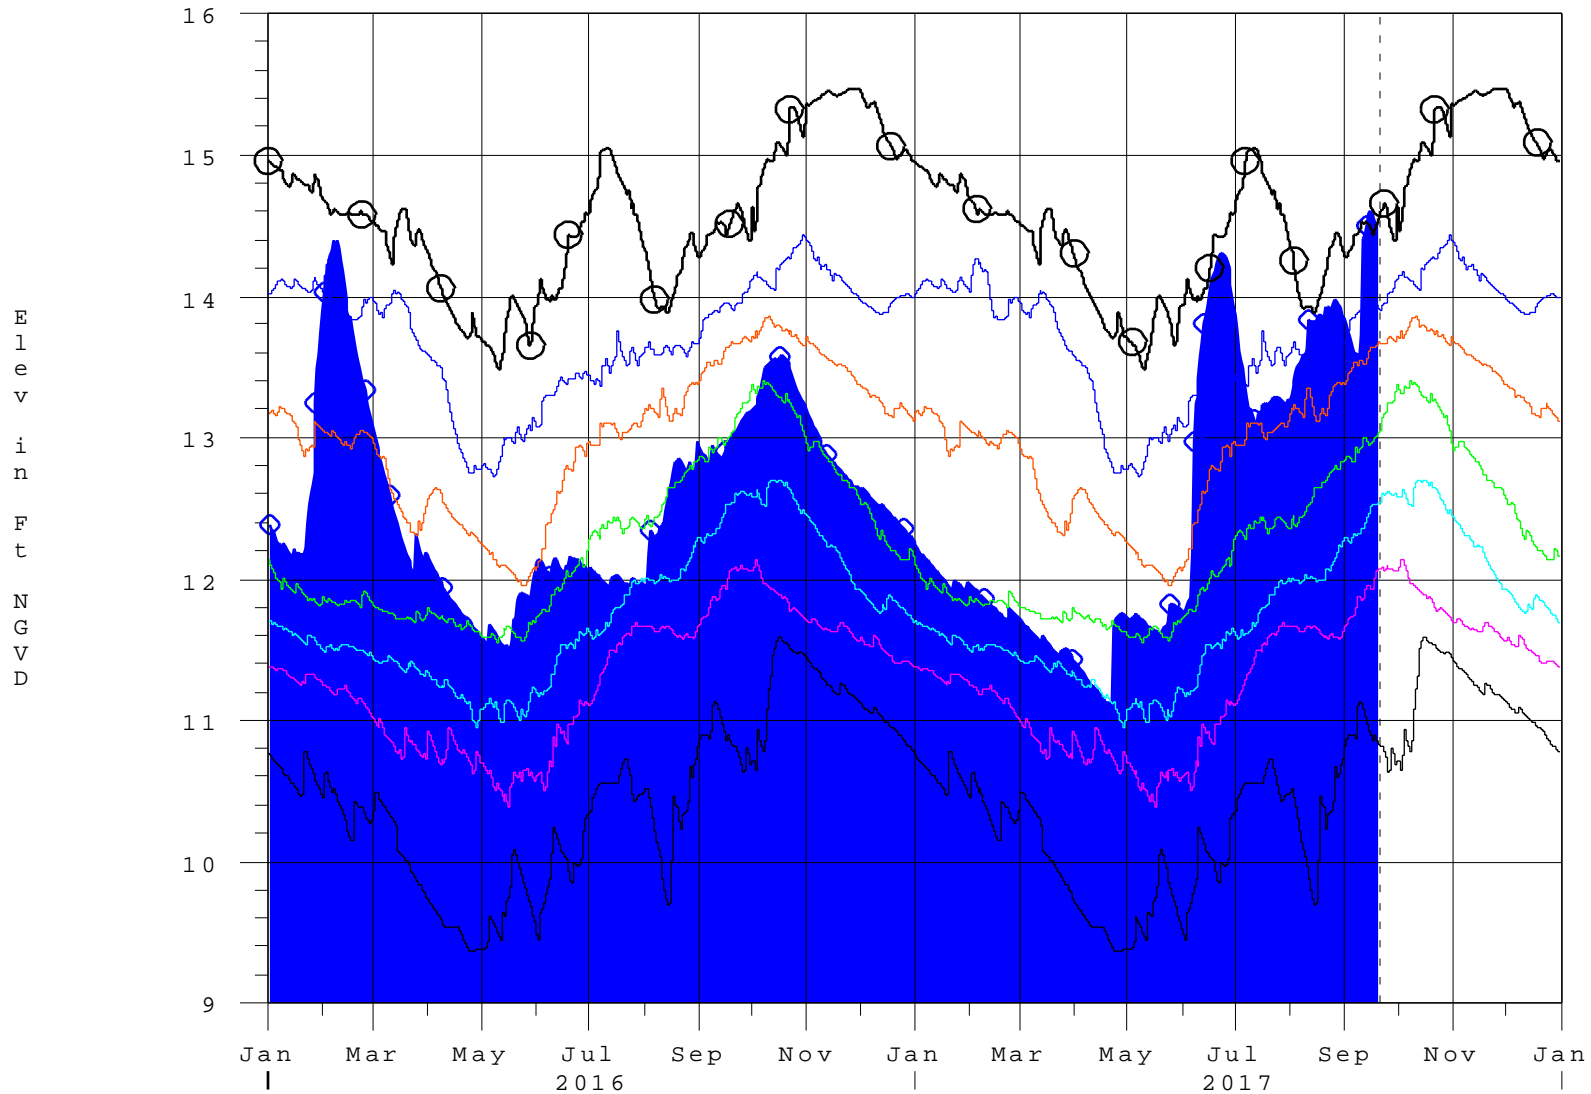

- ◇— Site 2-17
- 90% Exceed Value
- 75% Exceed Value
- 50% Exceed Value

- 25% Exceed Value
- 10% Exceed Value
- Min Exceed Value
- Max Exceed Value