


# Water Cons. Area #3A Compared to 1962-2016 Exceedance Statistics

19SEP17 23:45:33

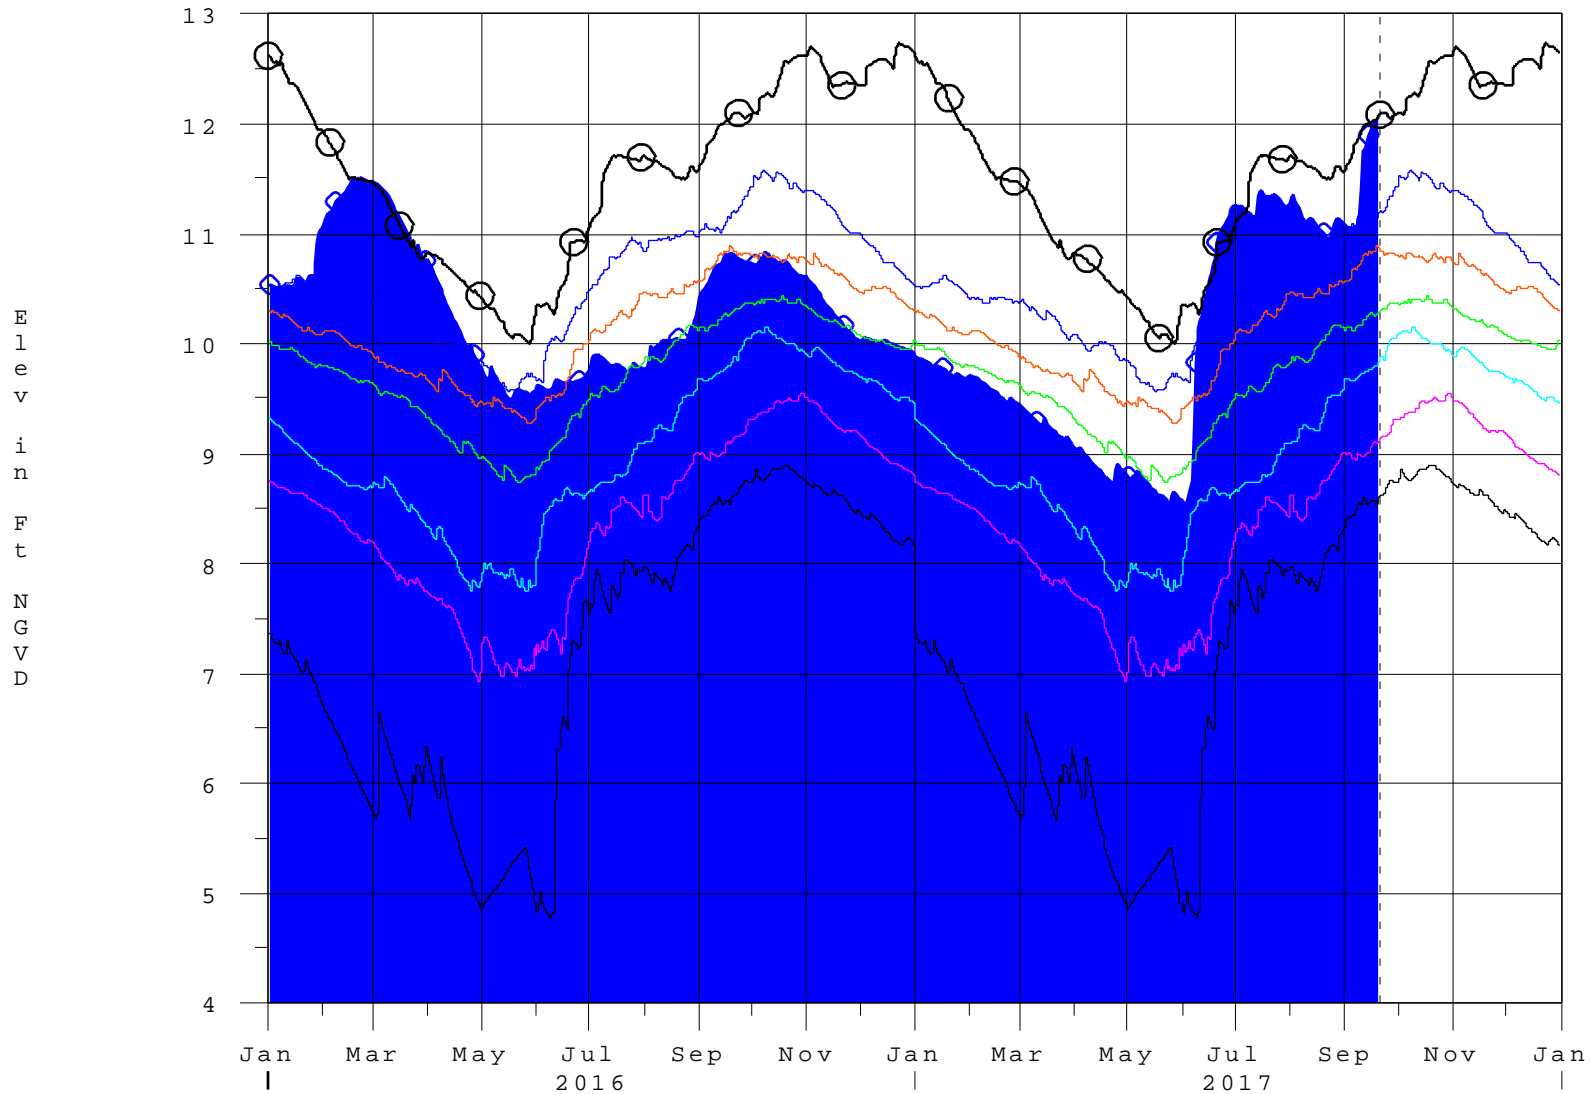

—◇— Avg Elev (Site 63,64,65)  
— 90% Exceed Value  
— 75% Exceed Value  
— 50% Exceed Value

— 25% Exceed Value  
— 10% Exceed Value  
— Min Exceed Value  
—○— Max Exceed Value